

"POLNA" S.A

37-700 Przemyśl, Obozowa 23 Str. E-mail: sales@polna.com.pl Tel.: +48 16 678 66 01

www.polna.com.pl

SELF-ACTUATING RELIEF PRESSURE REGULATORS TYPE ZSN3

APPLICATION AREA:

Regulators ZSN3 are used to control preset pressure in process installations connected to regulator valve inlet. Regulators are applied in heating systems, in industrial processes with cold and hot water, steam, air and non-flammable gases. Using with other media subject to consulting with manufacturer.

DESIGN:

Regulator comprises three, temporary fastened main units: valve (01), actuator (02) and adjuster (03). Regulator valve single-ported with balanced plug. Flanged connections of valve body with valve face as per PN-EN 1092-1:2006 and PN-EN 1092-2:1999 for PN10; 16; 25; 40

PN-EN 1759-1:2005 for CL150: CL300.

Body length as per:

PN-EN 60534-3-1:2000 - Series 1 for PN10; 16; 25; 40;

Series 37 for CL150: Series 38 for CL300

Valve tightness – bubble (Class VI as per PN-EN 60534-4), tight seat in PTFE or VMQ (ECOSIL).

Diaphragm actuator (diaphragm effective area 80 cm²), with clammed housing or diaphragm actuator (diaphragm effective area 160 cm²), with bolted housing.

Control pressure value adjuster with combination of three pre-tensioned springs, fixed coaxially with valve and actuator.



VARIANTS:


By corrosion-proofness of actuator components:


- standard (ZSN 3.1) carbon steel with protection coatings,
- special (ZSN 3.2) stainless steel.

OPERATING PRINCIPLE:

Valve is closed when no supply. Controlled pressure is fed via impulse duct through connection (24) under diaphragm (29) of actuator (02). Actuator second chamber is connected to atmosphere via deaeration plug (25). Increase in control pressure above preset value, set by tensioning of spring unit (60) in adjuster (03), causes deflection of diaphragm, movement of actuator stem (37) and opening of valve plug (5) until controlled pressure reaches value preset in booster.

Impulse collection point for controlled pressure is to be located upstream valve inlet.

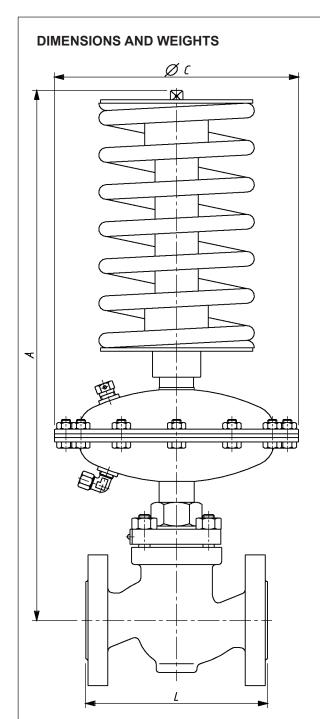

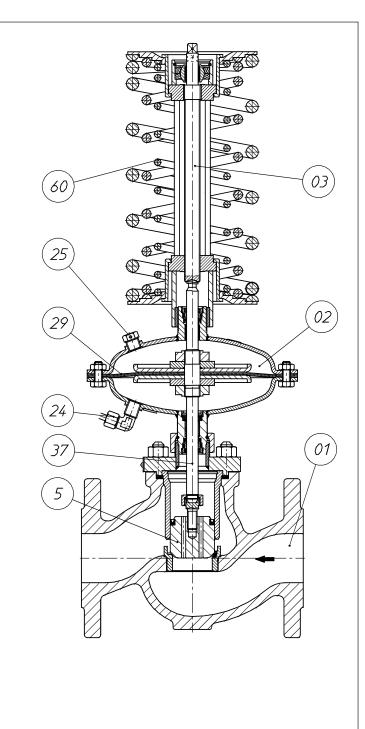

DIMENSIONS AND WEIGHTS

	A	L	Valve weight		
DN			(01)		
	[m	[kg]			
15		130	4,0		
20	470	150	5,1		
25		160	5,6		
32	485	180	8,5		
40	490	200	10,6		
50	495	230	14		
65	605	290	23		
80	005	310	29		
100	615	350	44		
125	specia	special execution, technical data			
150	according to individual inquiries				

				Weight		
Spring range	С	Actus	Actuator Adju		ster (03)	
[kPa]	[mm]	effective area[cm ²]	(02)	DN	DN	
			(02)	1550	65100	
40160	215	160	4.4	3,2	3,6	
100400	213	160	4,4	5,6	7,1	
200800	150	80	2.4	0	0.5	
2801120	130	60	2,4	6,8	8,5	
	oth	er spring ranges avai	lable on red	quest		

TECHNICAL SPECIFICATIONS

	DN	15	20	25	32	40	50	65	80	100	125	150
	full flow	3,2	5	8	12,5	20	32	50	80	125		
K _{vs} 1) [m³/h]	reduced flow	1 1,6	1,6 2,5	2,5 3,2	5	8	12,5	20	32	50		
[111711]	reduced now	2,5	3,2	5,2			12,5	20	32	30		
	Stroke [mm]		6			8	•	1	2	14	, l	
Nois	se coefficient Z	0,65	0,6	0,	55	0,45	0,	4	0,3	35	data	iries
Contr	ol characteristics				pro	portional					Jica Isa	ingu
Sprir	ng range [kPa] 2)		4016	50; 1	00400;	200	800;	280	1120		echr	
С	pressure in actuator hamber [bar]					20					tion, t	ndivic
	ed pressure drop n valve [bar]			1:	2				10		special execution, technical data	according to individual inquiries
			Vä	alve body	in grey iro	n			PN 16		Sial	ordi
Valve	nominal pressure		valve	body in s	pheroidal	iron		PN 16	; PN 25;	PN 40	sbei	acc
		val	ve body in	carbon st	eel and s	tainless s	teel	PN 16	; PN 25;	PN 40		
Max	kimum medium			wa	ter				200			
	nperature [°C]			stea	am				200			
	iporataro [O]			gas	es				80			

 $^{^{\}rm 1)}$ other flow ratios $\rm K_{\rm \tiny vs}$ subject to order specification. $^{\rm 2)}$ other ranges subject to order specification.

MATERIALS as per PN

Regulator	ZSN 3.1	ZSN 3.2				
	VALVE (01)					
Body	grey iron EN-GJL-250 spheroidal iron EN-GJS-400-178LT carbon steel GP240GH (1.0619) stainless steel GX5CrNiMo 19-11-2 (1.4408)					
Plug and seat	VCC+NIM	OT: 17 10 0 /1 4571)				
Guide sleeve	- X6CrNiMoTi 17-12-2 (1.4571)					
Packing	EF	EPDM ³⁾				
	ACTUATOR (02)					
Housing	carbon steel S235JRG2C (1.0122)	stainless steel X6CrNiTi 18-10 (1.4541)				
Stem	X17CrNi 16-2 (1.4057)					
Diaphragm	EPDM + pc	lyester fabric ³⁾				
Packing	EF	PDM ³⁾				
	Adjuster (03)					
Adjuster components	carbon stee	l C45 (1.0503)				
Springs	spring s	teel 60Si7				

³⁾ other materials, subject to medium type.

NOMINAL PRESSURE, WORKING TEMPERATURE AND WORKING PRESSURE

Material: EN-GJL 250 as per PN-EN 1561						
	Temperature [°C]					
PN	Standard	-10120	150	180	200	
		Allowable working pressure [bar]				
PN10	PN-EN 1092-2	10	9	8,4	8	
PN16	PN-EN 1092-2	16	14,4	13,4	12,8	

Ma	aterial: EN-GJS 4	100-18 LT as pe	er PN-E	N 1563		
		Temperature [°C]				
PN	PN Standard	-10120	150	200		
		Allowable working pressure [bar]				
PN10	PN-EN 1092-2	10	9,7	9,2		
PN16		16	15,5	14,7		
PN25		25	24,3	23		
PN40		40	38,8	36,8		


)				
3				
3				
3				
3-4				
Temperature [°C]				
)				
Allowable working pressure [bar]				
1				
-				

⁴⁾ other standards on request

INSTALLATION

Regulator is to be installed on horizontal pipeline. Medium flow direction is to conform to arrow on body. At medium temperature lower than 130°C regulator position is optional, at higher temperatures it is recommended to install regulator with adjuster unit (03) down. To ensure reliable operation of regulator apply strainer FS1 upstream and needle valve ZWD 1 at impulse collection point. When applying regulator for steam installation of condensation tank is recommended.

EXAMPLES OF APPLICATION

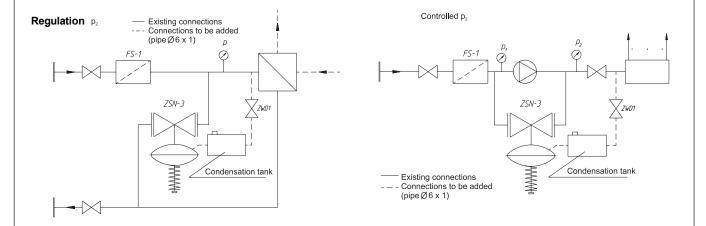

ACCESSORIES

Delivered:

- nut and cutting ring for impulse tube,

Optional (ordered separately):

- strainer FS1,
- straight tube connection Ø 6×1,
- connection stub NPT 1/4"
- impulse tube Ø 6×1,
- adjustment wrench,
- condensation tank,
- needle valve ZWD 1.

ORDERING

In your order specify regulator type and marking, ZSN 3.1 or ZSN 3.2, DN nominal diameter, PN nominal pressure, flow ratio K_{vs} , body material, spring range.

Example of order:

ZSN 3.1 - DN 32; PN 16; Kvs 8; spheroidal iron; 200...800 kPa.